




## TOWN OF PERINTON

1350 TURK HILL ROAD. FAIRPORT, NEW YORK 14450-8796  
(585) 223-0770, Fax: (585) 223-3629, [www.perinton.org](http://www.perinton.org)

### BUILDING PERMIT REQUIREMENTS FOR DECKS


1. Submit two copies of a tape location or instrument survey map of the property indicating the proposed location, distance to property lot lines and any overhead wires.
2. Submit two copies of a detailed construction drawing showing a **cross section** (see page 2) and the **top view** (see page 3) with footing depth, connection at house, and deck height above grade. Indicate the size of joists and the distance between beams and house. Indicate size of beams and distance between posts. Provide a detail of proposed guardrails, handrails and stairs. Include an overview showing overall measurements, beams and posts. Approved flashing is required at all points of attachment to the house.
3. Please add the property address to all paperwork submitted.
4. Provide an estimated cost of construction.
5. If construction is being done by a contractor, they must have **General Liability, Workers' Compensation and Disability Benefits** insurance on file with the Town of Perinton before a permit can be issued. Please call the Code Enforcement and Development Department with any questions.
6. Check with the Code Enforcement and Development Department for the required setbacks for the property.
7. Plan review is done by our staff prior to issuing a building permit. After receiving the above information, this review is done in a timely manner. During busy times, the review of a minor project could take up to five business days. We always try to expedite the review, but planning ahead helps us all.
8. At least 24 hours notice is required for inspections. Required inspections are noted on the building permit.
9. Footers must be 42 inches deep and must be inspected before concrete is placed.
10. A Certificate of Compliance (final inspection) is required on all deck permits. **It is the responsibility of the homeowner** to assure that a final inspection has passed and a **Certificate of Compliance has been issued.**
11. Permit Fee: \$.10 per square foot with a \$15 minimum charge.

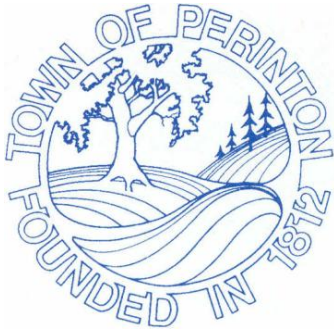


# TOWN OF PERINTON

1350 TURK HILL ROAD, FAIRPORT, NEW YORK 14450-8796  
 (585) 223-0770, Fax: (585) 223-3629, www.perinton.org

## Example Deck Cross Section

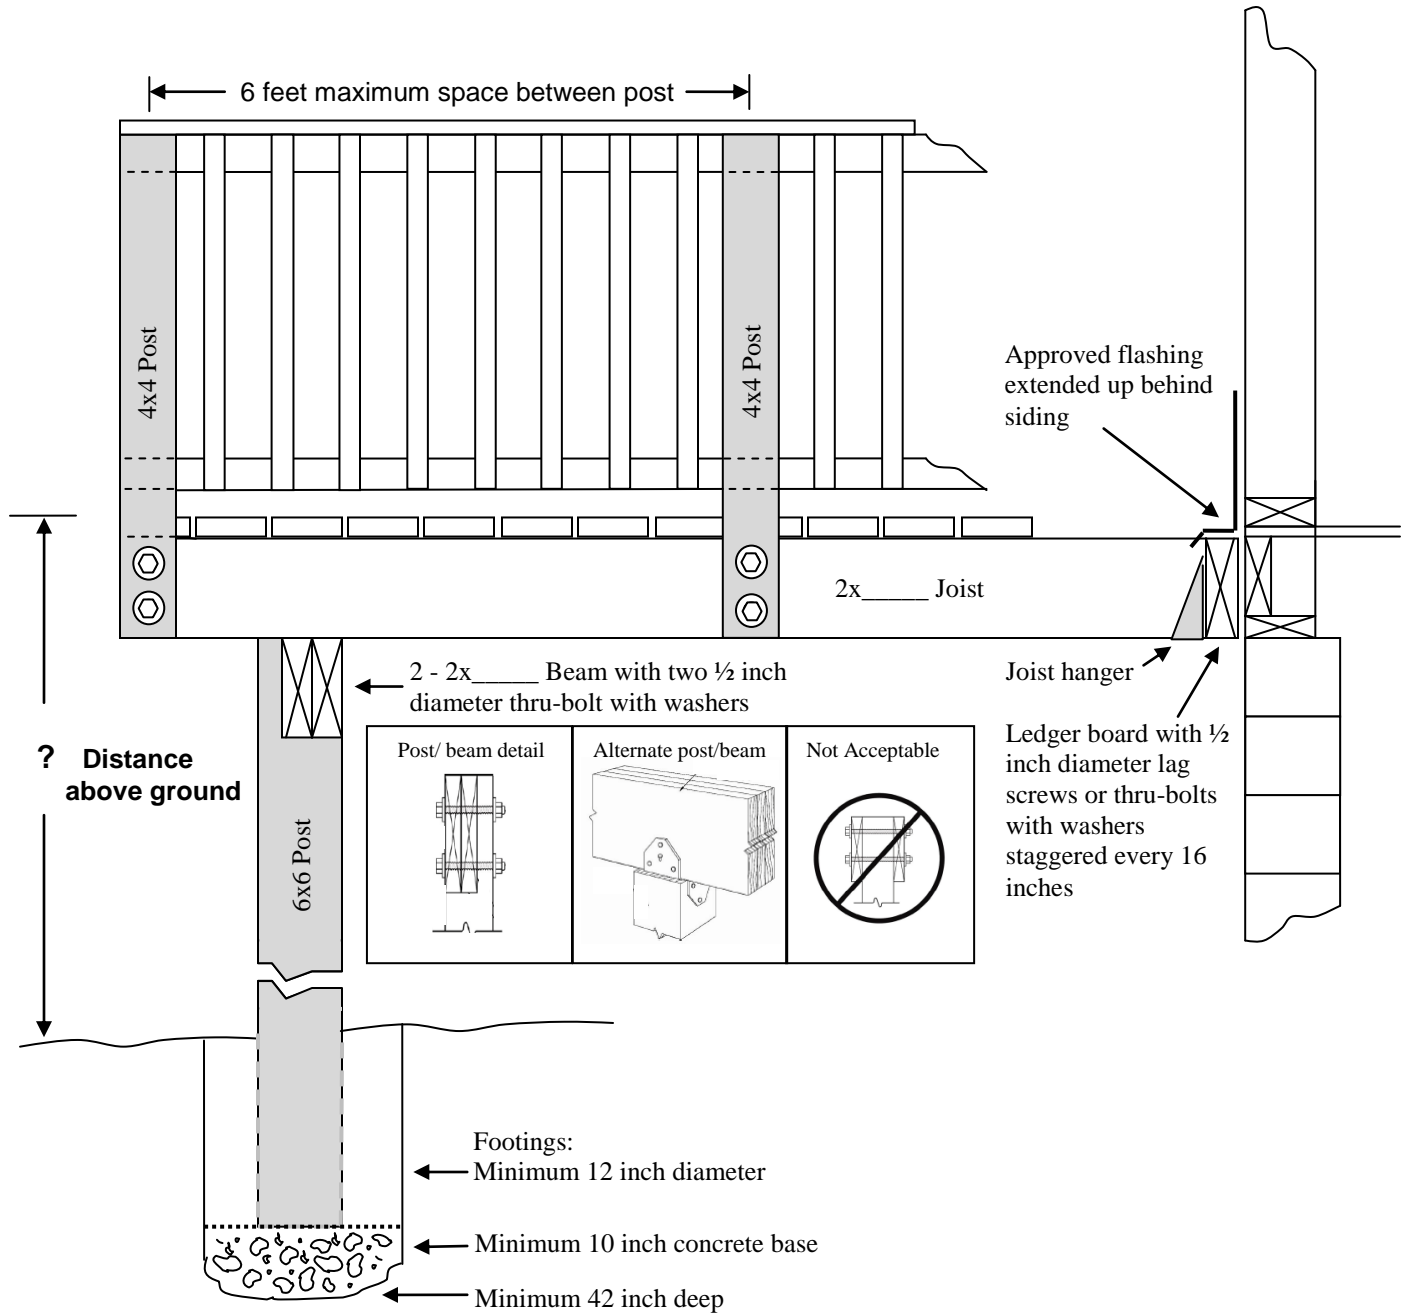

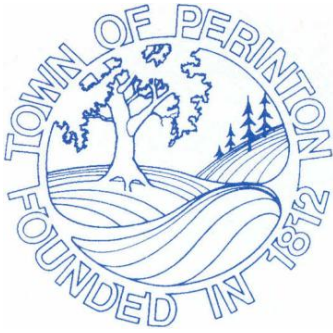

## TOWN OF PERINTON

1350 TURK HILL ROAD, FAIRPORT, NEW YORK 14450-8796  
 (585) 223-0770, Fax: (585) 223-3629, www.perinton.org

### Span Limitations for Joist and Beams

**Spans for joist at 16 inch on center:**  $2 \times 8 = 10' - 6''$  •  $2 \times 10 = 15' - 2''$  •  $2 \times 12 = 17' - 10''$


**Maximum cantilever for joist:**  $2 \times 6 = 24''$  •  $2 \times 8 = 30''$  •  $2 \times 10 = 36''$  •  $2 \times 12 = 36''$


**Spans for beams:** (2)  $2 \times 6 = 4'$  • (2)  $2 \times 8 = 6'$  • (2)  $2 \times 10 = 8'$  • (2)  $2 \times 12 = 10'$

Beams can extend past end post a maximum distance of 1 foot

### Example Deck Top View

- Add beams as needed to fit your design.
- Fill in dimensions to fit your design.
- Indicate the distance from the ground to the top of the deck.
- **Decks can be free standing and not attached to the house, this would require additional beams.**

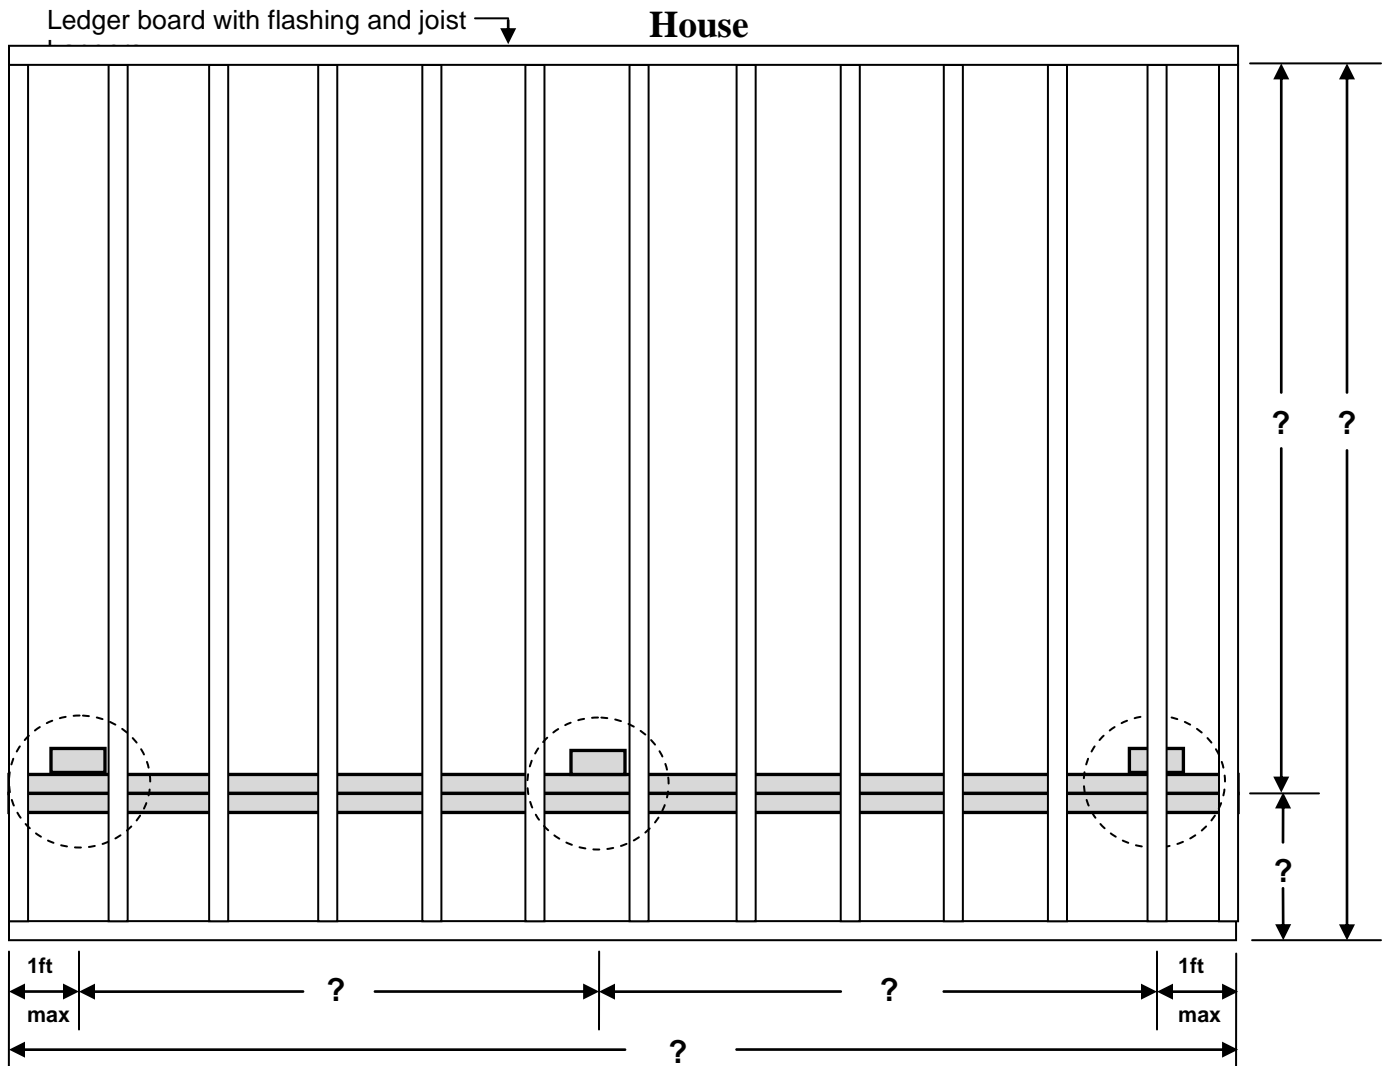


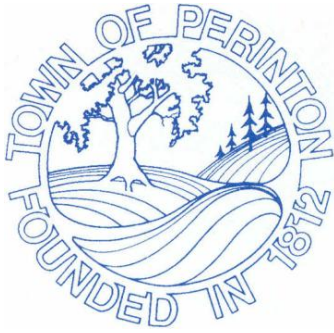


## TOWN OF PERINTON

1350 TURK HILL ROAD, FAIRPORT, NEW YORK 14450-8796  
(585) 223-0770, Fax: (585) 223-3629, www.perinton.org

### Example Pool Deck Top View

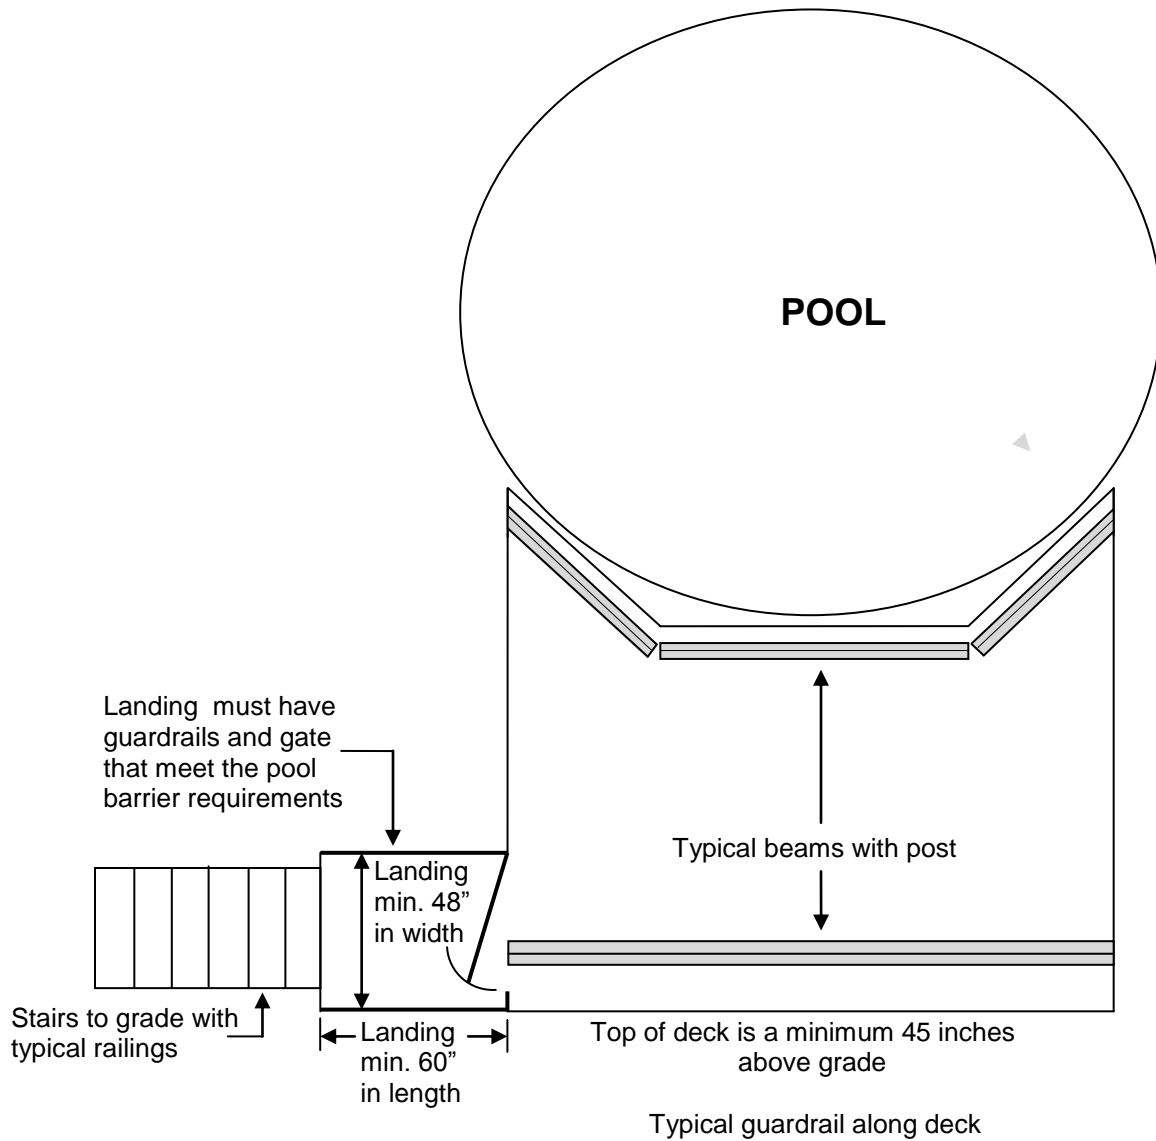

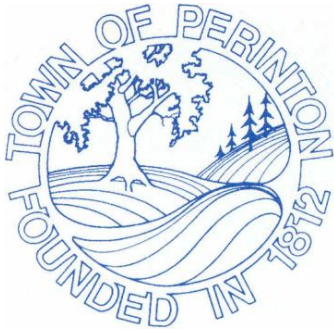

## TOWN OF PERINTON

1350 TURK HILL ROAD. FAIRPORT, NEW YORK 14450-8796  
(585) 223-0770, Fax: (585) 223-3629, [www.perinton.org](http://www.perinton.org)

### Guide Lines for Handrails and Guards

#### Handrails and guards are two different components.


- A **handrail** is a horizontal or sloping rail intended for grasping by the hand for guidance or support.
- A **guardrail** is a building component located at the open sides of elevated walking surfaces and stairs that minimizes the possibility of a fall from the walking surface to the level below.

#### Handrails:

1. Handrails shall be continuous on at least one side of each continuous run stairs with 4 or more risers.
2. Top of handrails shall be placed no less than 34 inches or more than 38 inches above the stair nosing.
3. Handrails must be continuous the entire length of the stairs, from a point directly above the top riser to a point directly above the lowest riser, and return to a wall or post.
4. Handrails shall be placed at least 1-1/2 inches from any wall or other obstruction and cannot project more than 4-1/2 inches over the stairs.
5. The handgrip area shall not be less than 1-1/4 inches or more than 2-3/4 inches in width.
  - a. **Type I:** Handrails with a circular cross section shall have an outside diameter of at least 1-1/4 inches and not greater than 2 inches. If the handrail is not circular it shall have a perimeter dimension of at least 4 inches and not greater than 6-1/4 inches with a maximum cross section dimension of 2-1/4 inches.
  - b. **Type II:** Handrails with a perimeter greater than 6-1/4 inches shall provide a graspable finger recess area on both sides of the rail. The finger recess shall begin within a distance of 3/4 inch measured vertically from the tallest portion of the profile and achieve a depth of at least 5/16 inch within 7/8 inch below the widest portion of the profile. This required depth shall continue for at least 3/8 inch to a level that is not less than 1-3/4 inches below the tallest portion of the profile. The minimum width of the handrail above the recess shall be 1-1/4 inches to a maximum of 2-3/4 inches. Edges shall have a minimum radius of 0.01 inch.

#### Guards:

1. Open sides of stairs with a total rise of more than 30 inches above the floor or grade below shall have guards not less than 34 inches in height measured vertically from the nosing of the treads.
2. The requirement for guards along open sides of stairs not only applies to the portion of a stairway that is more than 30 inches above the adjacent floor, but it also applies to any portion of a flight of stairs less than 30 inches above the floor.
3. All guards shall have intermediate rails or ornamental closures that prohibit the passage of a sphere 4 inches or more in diameter. The triangular openings formed by the riser, tread and bottom rail of a guard at the open side of a stairway are permitted to be of such a size that a 6-inch sphere cannot pass through.
4. When designed properly, the top rail of a guard can also serve as the required handrail.
5. See page 6.

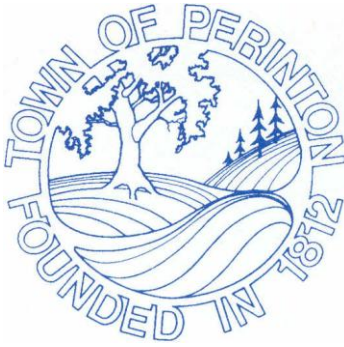


## TOWN OF PERINTON

1350 TURK HILL ROAD. FAIRPORT, NEW YORK 14450-8796  
 (585) 223-0770, Fax: (585) 223-3629, www.perinton.org


### HANDRAIL AND GUARD for STAIRS DETAIL, TYPICAL


Handrails must be continuous the full length of stairs  
 And cannot be interrupted by any post.

Guards are required for stairs with a total rise of  
 30 inches or more.

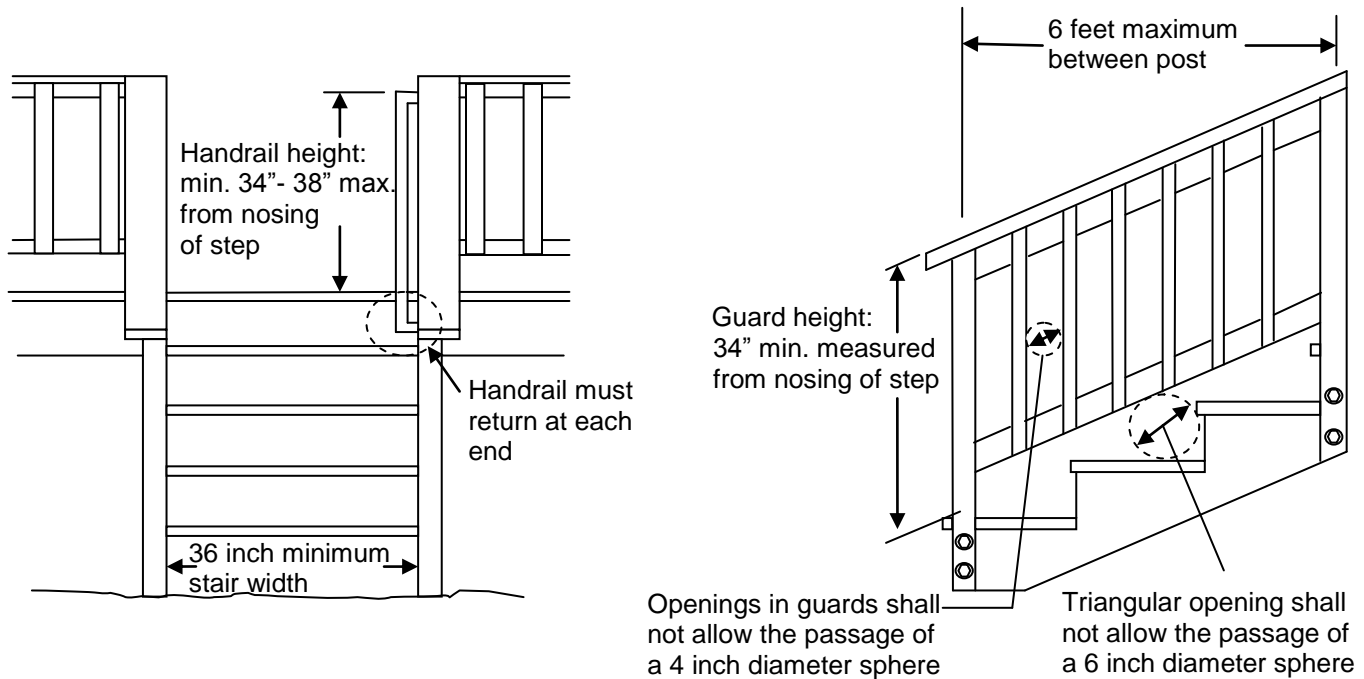

### Acceptable Handrail Profiles, typical


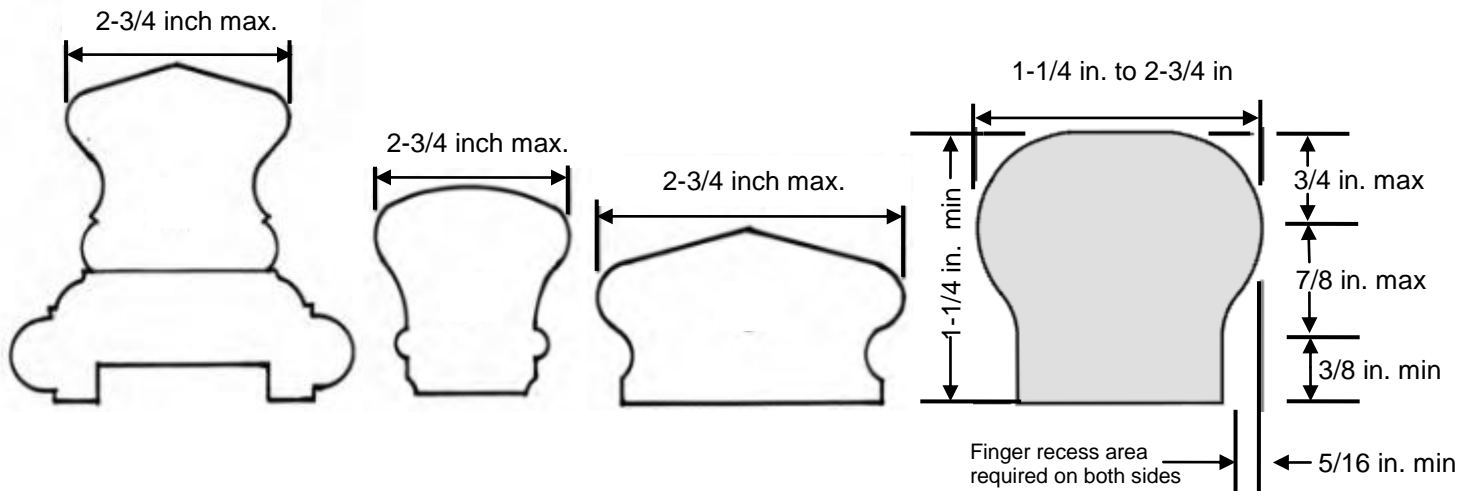


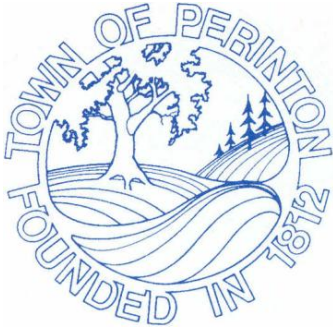


## TOWN OF PERINTON

1350 TURK HILL ROAD. FAIRPORT, NEW YORK 14450-8796  
 (585) 223-0770, Fax: (585) 223-3629, www.perinton.org

### GUARD DETAIL, TYPICAL

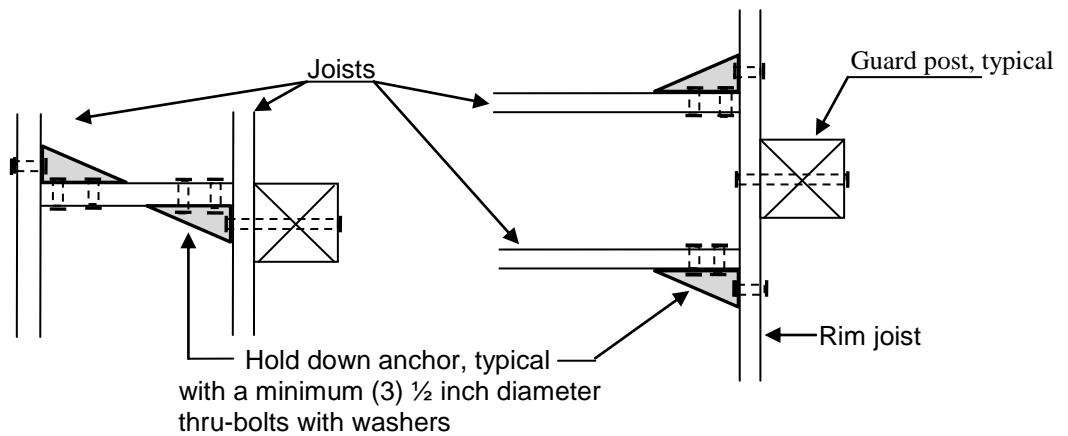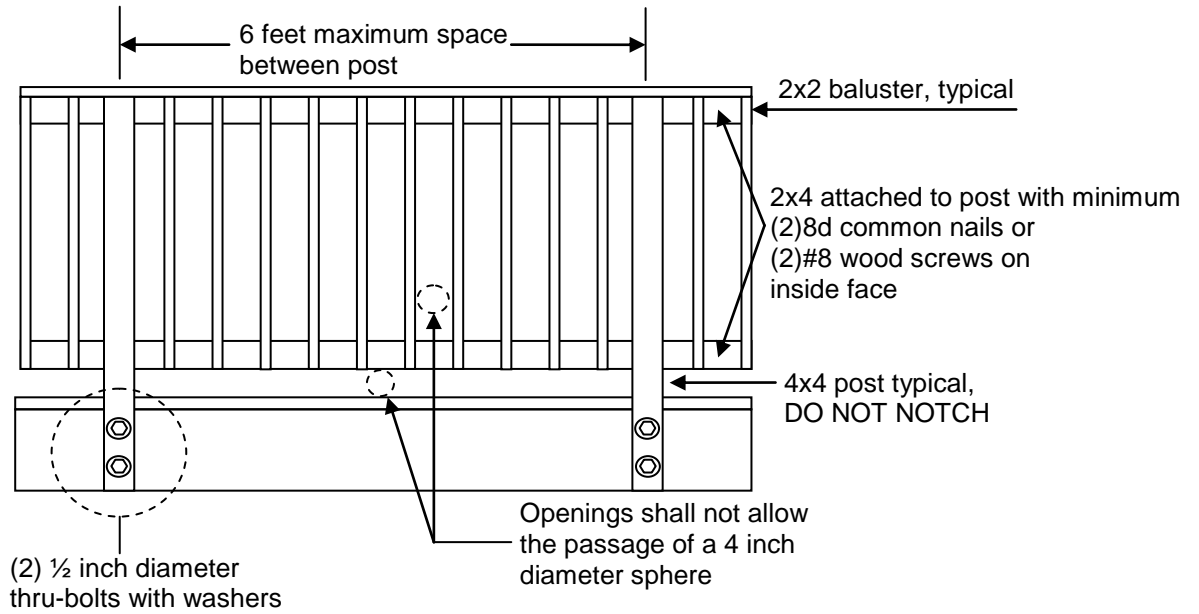



Post can be located on the inside of the joist.

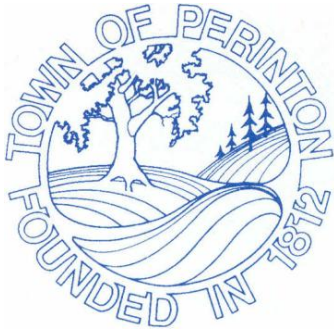

## TOWN OF PERINTON

1350 TURK HILL ROAD, FAIRPORT, NEW YORK 14450-8796  
 (585) 223-0770, Fax: (585) 223-3629, www.perinton.org

### STAIR DETAILS, TYPICAL

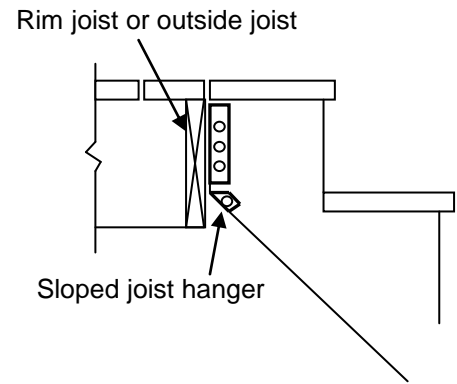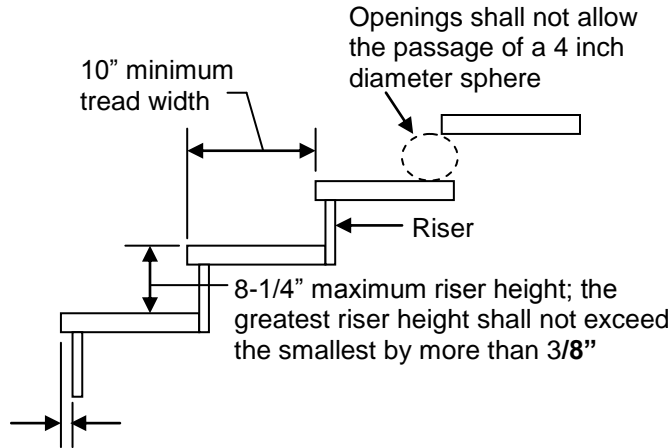

3/4"-1-1/4" nosing; the greatest nosing projection shall not exceed the smallest by more than 3/8"

